


TABLE-CONTROLLER

H21.1.7

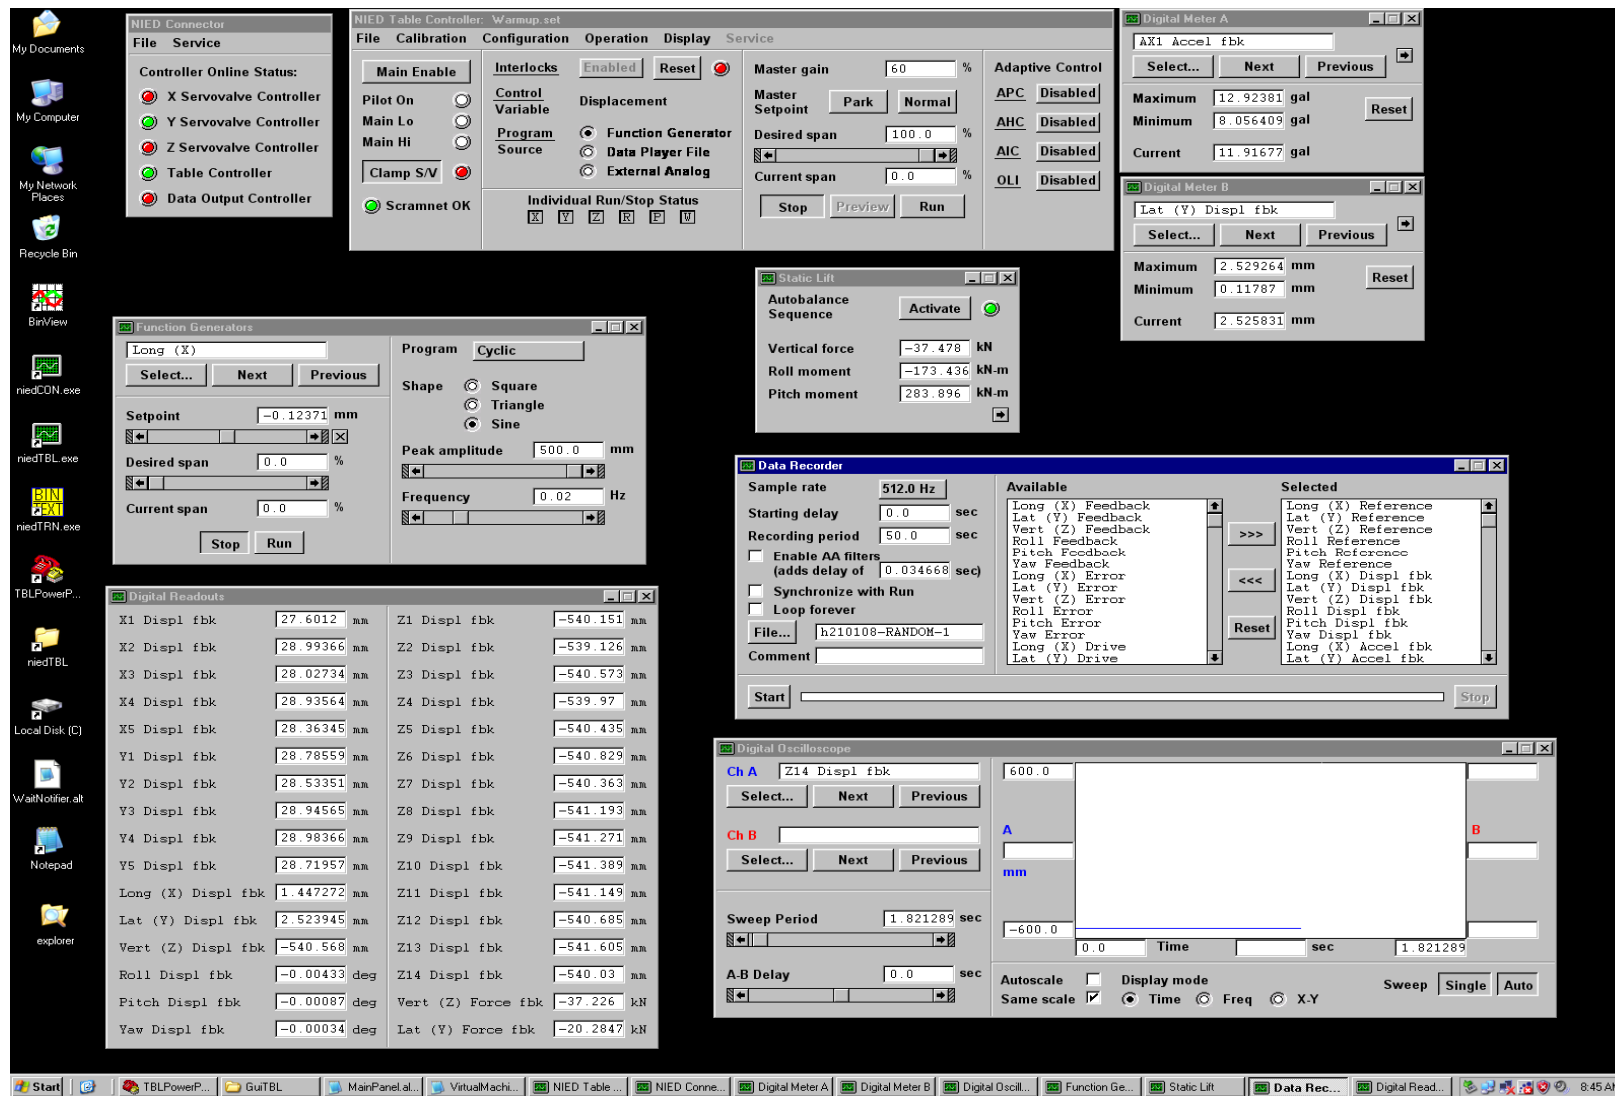

X-SERVO-CONTROLLER

My Documents

My Computer

My Network Places

Recycle Bin

BinView

niedSVX.exe

XPowerPC.ht

niedSVX

Local Disk (C)

bin

NIED X Servovalve Controller: SettingsSVX.set

File Calibration Operation View Service

Interlocks Disabled Reset

Master gain 50 %

Servovalves clamped

Scramnet OK

The realtime controller has unexpectedly quit.

You must quit this application and restart.

Okay

Digital Readouts

X1 displ fbk	27.6012	mm	X1 force fbk	-7.44097	kN
X2 displ fbk	28.99366	mm	X2 force fbk	0.35437	kN
X3 displ fbk	28.02534	mm	X3 force fbk	2.12178	kN
X4 displ fbk	28.93365	mm	X4 force fbk	1.180466	kN
X5 displ fbk	28.36145	mm	X5 force fbk	-0.23615	kN
X1A 4th-stg displ fbk	-9.92311	Volts	X4A 4th-stg displ fbk	-9.99228	Volts
X1B 4th-stg displ fbk	-9.94494	Volts	X4B 4th-stg displ fbk	9.989255	Volts
X1C 4th-stg displ fbk	9.960714	Volts	X4C 4th-stg displ fbk	-9.71235	Volts
X2A 4th-stg displ fbk	9.940196	Volts	X5A 4th-stg displ fbk	-9.97044	Volts
X2B 4th-stg displ fbk	10.05517	Volts	X5B 4th-stg displ fbk	-9.96811	Volts
X2C 4th-stg displ fbk	9.935327	Volts	X5C 4th-stg displ fbk	9.936563	Volts
X3A 4th-stg displ fbk	9.951044	Volts	X1 Command	-0.02265	Volts
X3B 4th-stg displ fbk	-10.0309	Volts	X2 Command	-0.02394	Volts
X3C 4th-stg displ fbk	9.919111	Volts	X3 Command	-0.02506	Volts
X5 Command	-0.02718	Volts	X4 Command	-0.02613	Volts

Start

XPowerPC - HyperTerminal

C:\niedSVX

NIED X Servovalve Contr...

Digital Readouts

8:35 AM

Z-SERVO-CONTROLLER

My Documents

My Computer

My Network Places

Recycle Bin

BinView

niedSVZ.exe

Shortcut to ZPowerPC.ht

niedSVZ

Local Disk (C)

bin

NIED Z Servovalve Controller: SettingsSVZ.set

File Calibration Operation View Service

Interlocks Disabled Reset

Master gain 60 %

Servovalves clamped

Scramnet OK

The realtime controller has unexpectedly quit.

You must quit this application and restart.

Okay

Digital Readouts

Z1 force fbk	0.589805 kN	Z1A 4th-stg displ fbk	10.00582 Volts
Z2 force fbk	12.86841 kN	Z2A 4th-stg displ fbk	9.981452 Volts
Z3 force fbk	-6.84434 kN	Z3A 4th-stg displ fbk	9.869361 Volts
Z4 force fbk	0.603195 kN	Z4A 4th-stg displ fbk	-9.9812 Volts
Z5 force fbk	-8.85265 kN	Z5A 4th-stg displ fbk	10.05499 Volts
Z6 force fbk	-21.7188 kN	Z6A 4th-stg displ fbk	9.972806 Volts
Z7 force fbk	-11.3266 kN	Z7A 4th-stg displ fbk	-9.9164 Volts
Z8 force fbk	4.234179 kN	Z8A 4th-stg displ fbk	9.909671 Volts
Z9 force fbk	-2.47733 kN	Z9A 4th-stg displ fbk	9.914354 Volts
Z10 force fbk	-6.8496 kN	Z10A 4th-stg displ fbk	9.927125 Volts
Z11 force fbk	4.035106 kN	Z11A 4th-stg displ fbk	-9.93351 Volts
Z12 force fbk	-8.03034 kN	Z12A 4th-stg displ fbk	9.882512 Volts
Z13 force fbk	5.328774 kN	Z13A 4th-stg displ fbk	-9.90229 Volts
Z14 force fbk	-2.59743 kN	Z14A 4th-stg displ fbk	-9.91908 Volts
Z1 accel fbk	1.426921 gal		
Z1 displ fbk	-540.151 mm	Z2 displ fbk	-539.126 mm

Start


ZPowerPC - HyperTerminal

NIED Z Servovalve Contr...


Digital Readouts

8:32 AM

DATA-OUTPUT-CONTROLLER

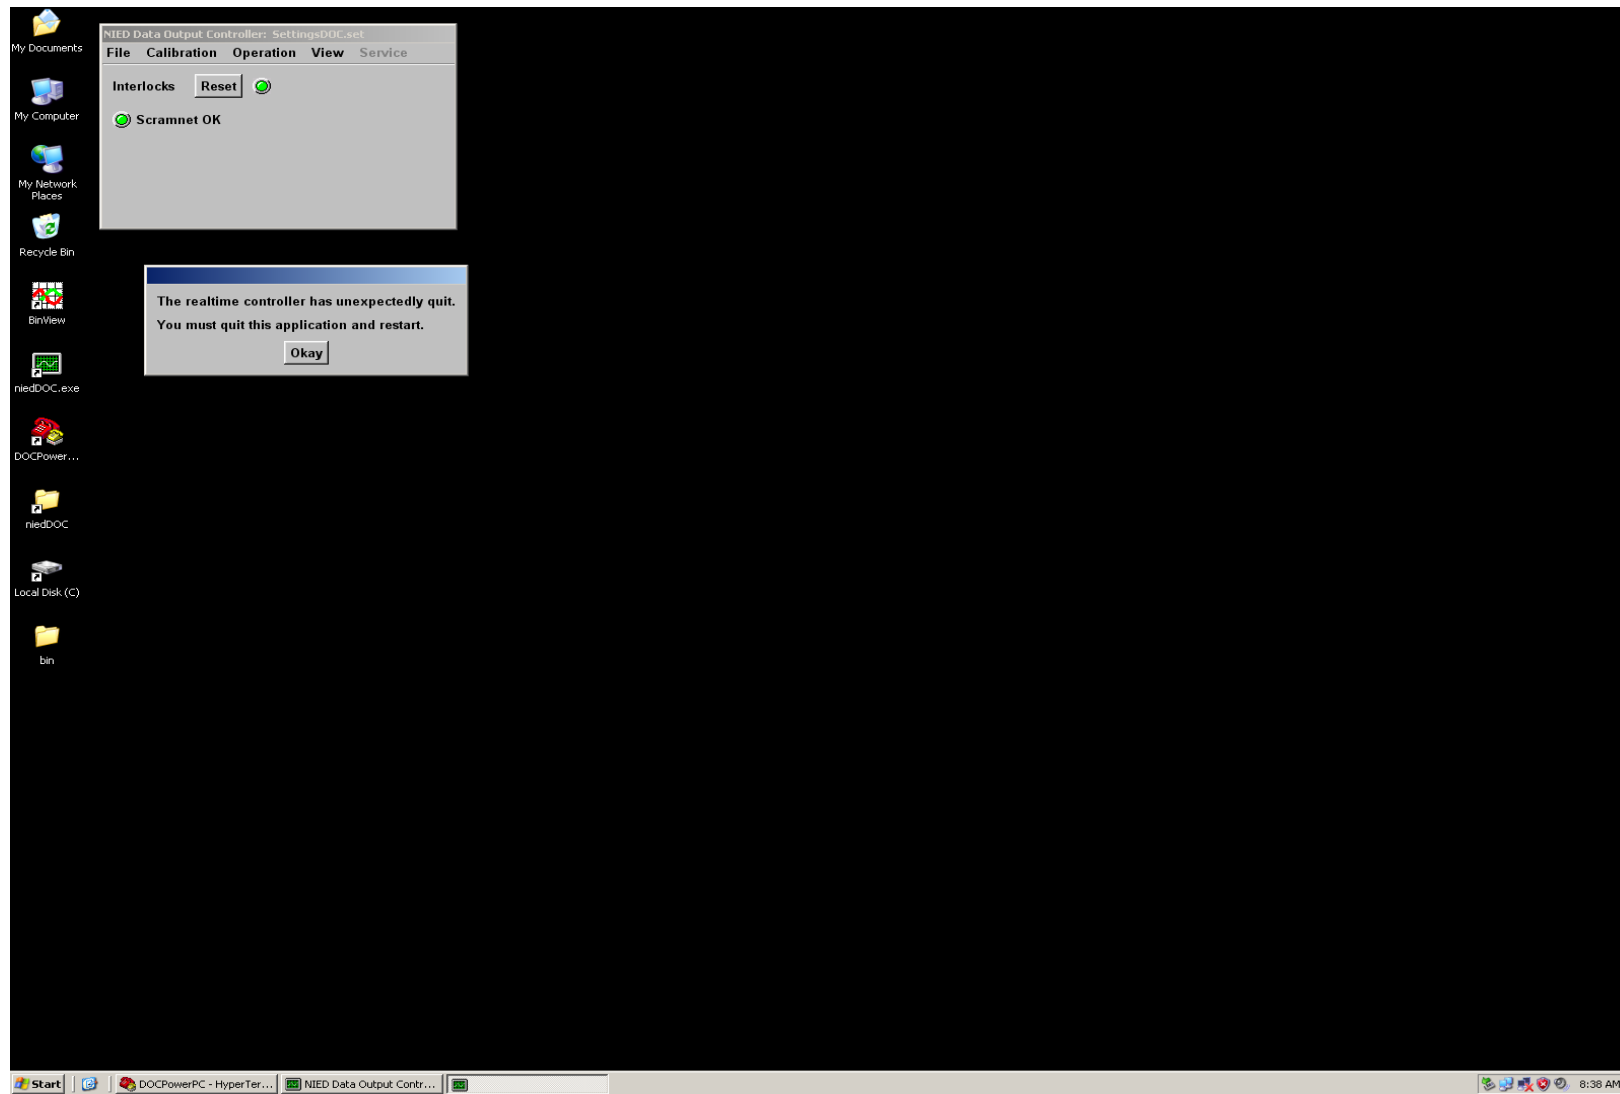

DATA-LOGGER

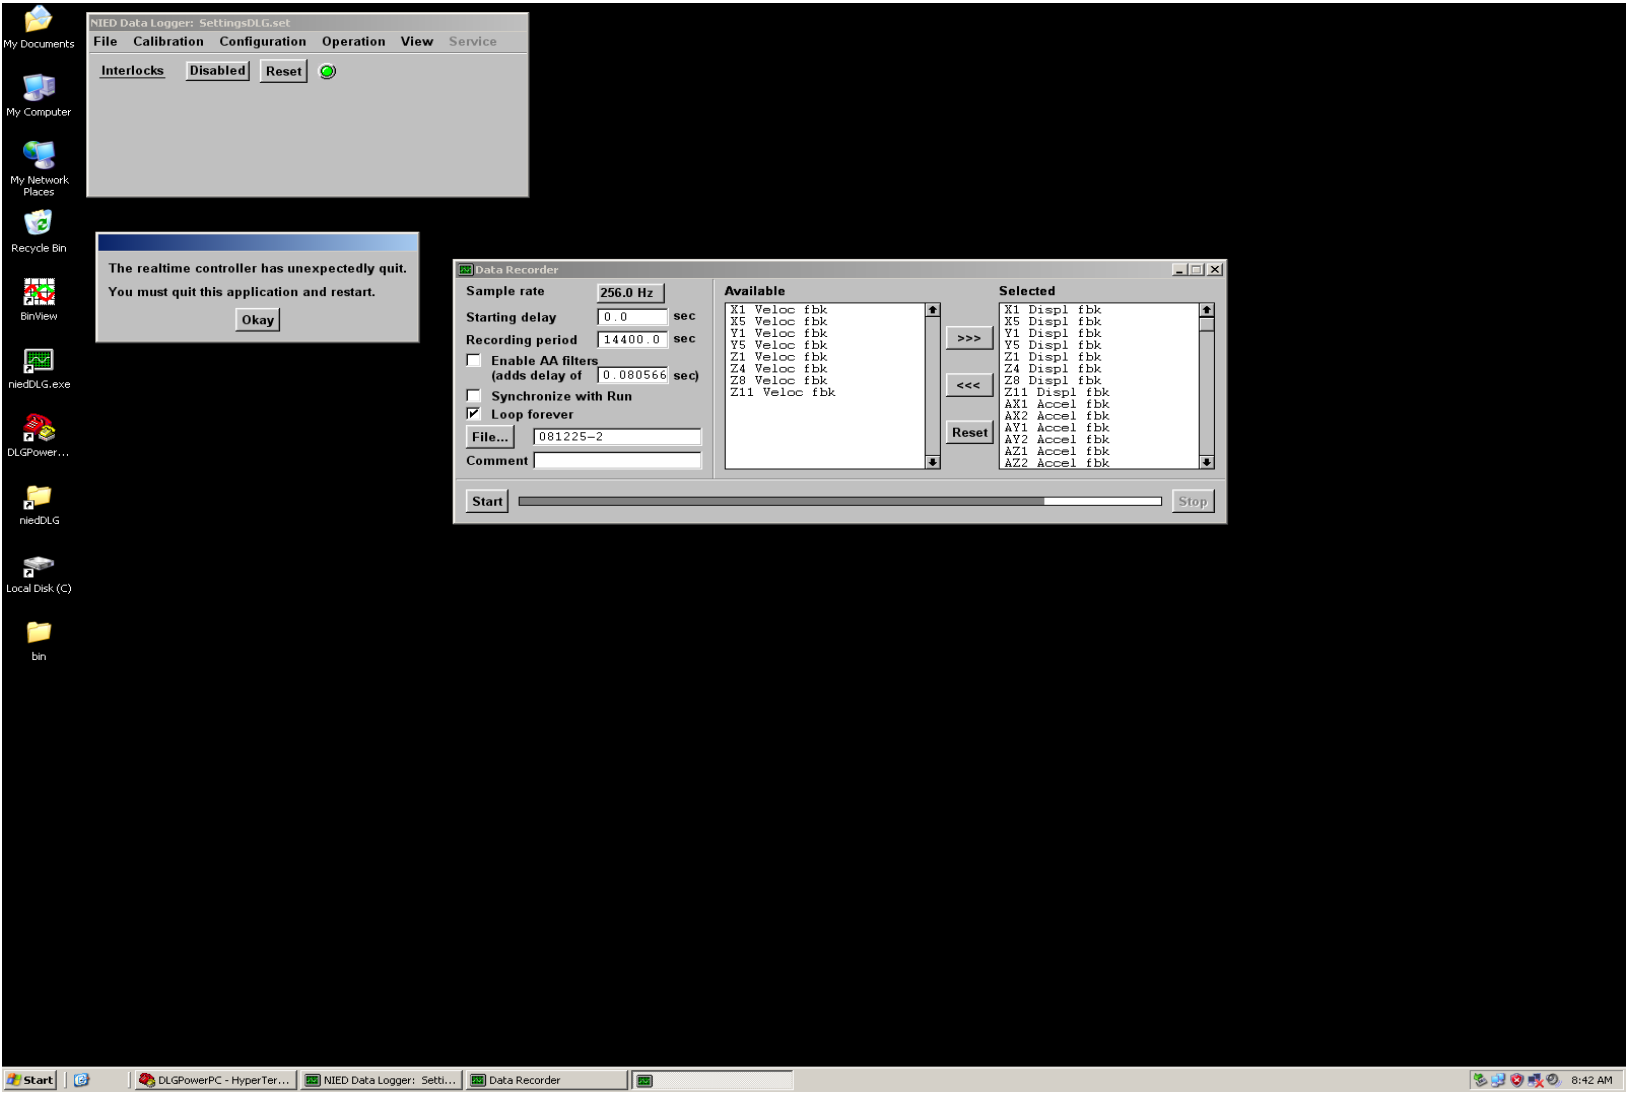

運転制御盤 警報履歴

MINIMONI									
2009.01.07 08:29:04 中央 2403 中央運転 異常発生									
2009.01.07 08:29:04 異常処理*****									
C:\MINIMONI\DATA\ENG\Tms32\ELV									
10000個									
0:	2009.01.07	08:33:31	システム	リセット					
1:	2009.01.07	08:29:17	2号機	潤滑油圧力確立	PB 押下	メッセージガイダンス			
2:	2009.01.07	08:29:17	1号機	潤滑油圧力確立	OFF	メッセージガイダンス			
3:	2009.01.07	08:29:15	4号機	潤滑油圧力確立	OFF	メッセージガイダンス			
4:	2009.01.07	08:29:13	3号機	潤滑油圧力確立	OFF	メッセージガイダンス			
5:	2009.01.07	08:29:05	4号機	運転準備条件確立	OFF	メッセージガイダンス			
6:	2009.01.07	08:29:05	3号機	運転準備条件確立	OFF	メッセージガイダンス			
7:	2009.01.07	08:29:05	2号機	運転準備条件確立	OFF	メッセージガイダンス			
8:	2009.01.07	08:29:05	1号機	運転準備条件確立	OFF	メッセージガイダンス			
9:	2009.01.07	08:29:04	リセ	リセ	定格無励磁	メッセージガイダンス			
10:	2009.01.07	08:29:04	リセ	リセ	定格無励磁	メッセージガイダンス			
11:	2009.01.07	08:29:04	リセ	リセ	定格無励磁	メッセージガイダンス			
12:	2009.01.07	08:29:04	リセ	リセ	定格無励磁	メッセージガイダンス			
13:	2009.01.07	08:29:04	4号機	冷却水ヒータ停止	停止	メッセージガイダンス			
14:	2009.01.07	08:29:04	4号機	冷却水循環ポンプ	停止	メッセージガイダンス			
15:	2009.01.07	08:29:04	4号機	潤滑油循環ポンプ	停止	メッセージガイダンス			
16:	2009.01.07	08:29:04	4号機	潤滑油ライジングポンプ	停止	メッセージガイダンス			
17:	2009.01.07	08:29:04	4号機	潤滑油ライジングポンプ	停止	メッセージガイダンス			
18:	2009.01.07	08:29:04	3号機	冷却水循環ポンプ	OFF	メッセージガイダンス			
19:	2009.01.07	08:29:04	3号機	潤滑油循環ポンプ	停止	メッセージガイダンス			
20:	2009.01.07	08:29:04	3号機	潤滑油ライジングポンプ	停止	メッセージガイダンス			
21:	2009.01.07	08:29:04	3号機	潤滑油ライジングポンプ	停止	メッセージガイダンス			
22:	2009.01.07	08:29:04	2号機	冷却水ヒータ停止	OFF	メッセージガイダンス			
23:	2009.01.07	08:29:04	2号機	冷却水循環ポンプ	停止	メッセージガイダンス			
24:	2009.01.07	08:29:04	2号機	潤滑油循環ポンプ	停止	メッセージガイダンス			
25:	2009.01.07	08:29:04	2号機	潤滑油ライジングポンプ	停止	メッセージガイダンス			
26:	2009.01.07	08:29:04	2号機	潤滑油ライジングポンプ	停止	メッセージガイダンス			
27:	2009.01.07	08:29:04	1号機	冷却水循環ポンプ	OFF	メッセージガイダンス			
28:	2009.01.07	08:29:04	1号機	潤滑油循環ポンプ	停止	メッセージガイダンス			
29:	2009.01.07	08:29:04	1号機	潤滑油ライジングポンプ	停止	メッセージガイダンス			
30:	2009.01.07	08:29:04	1号機	潤滑油ライジングポンプ	停止	メッセージガイダンス			
31:	2009.01.07	08:29:04	テフ	Hydraulic Enable	OFF	メッセージガイダンス			
32:	2009.01.07	08:29:04	加振制御装置	加振制御終了指令	ON	メッセージガイダンス			
33:	2009.01.07	08:29:04	4号機	遠隔非常停止指令	ON	メッセージガイダンス			
34:	2009.01.07	08:29:04	3号機	遠隔非常停止指令	ON	メッセージガイダンス			
35:	2009.01.07	08:29:04	2号機	遠隔非常停止指令	ON	メッセージガイダンス			
36:	2009.01.07	08:29:04	1号機	遠隔非常停止指令	ON	メッセージガイダンス			
37:	2009.01.07	08:29:04	異常処理*****		*	メッセージガイダンス			
38:	2009.01.07	08:29:04	2403 中央運転 異常発生		発生	メッセージアラーム	中央		
39:	2009.01.07	08:29:04	0607 Hydraulic Enable OFF		発生	メッセージアラーム	中央		
40:	2009.01.07	08:29:04	0601 テフコントローラ Stop2		発生	メッセージアラーム	中央		
41:	2009.01.07	08:24:15	1号機	冷却水ヒータ停止	停止	メッセージガイダンス			
42:	2009.01.07	08:21:05	3号機	冷却水ヒータ停止	停止	メッセージガイダンス			
43:	2009.01.07	07:51:00	4号機	冷却水ヒータ運転	運転	メッセージガイダンス			
44:	2009.01.07	07:47:15	2号機	冷却水ヒータ運転	運転	メッセージガイダンス			

「F1」を押してください。

実行中